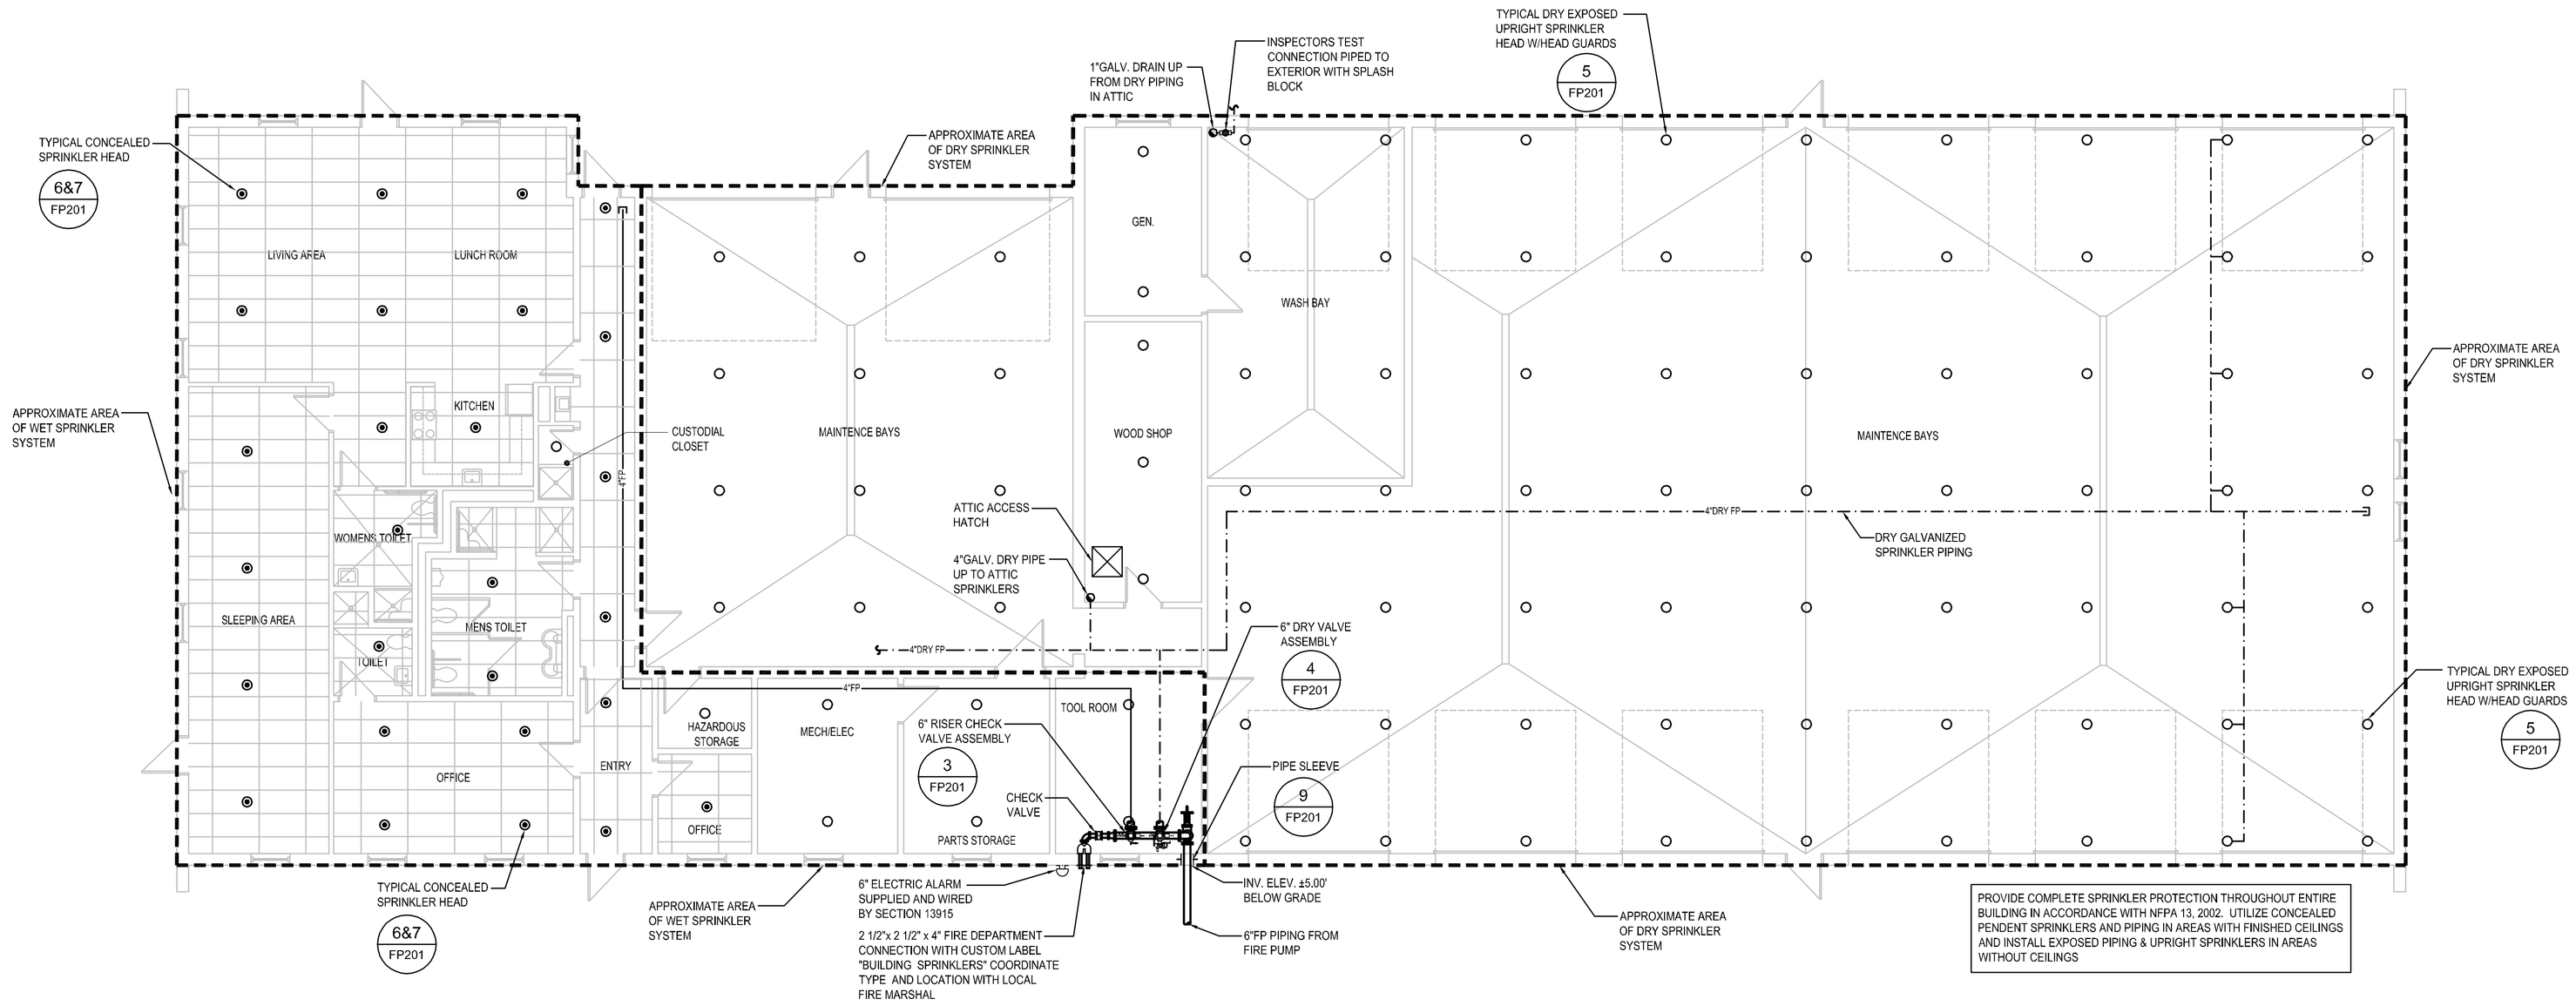

PROVIDE COMPLETE SPRINKLER PROTECTION THROUGHOUT ENTIRE BUILDING IN ACCORDANCE WITH NFPA 13, 2002. UTILIZE CONCEALED PENDENT SPRINKLERS AND PIPING IN AREAS WITH FINISHED CEILINGS AND INSTALL EXPOSED PIPING & UPRIGHT SPRINKLERS IN AREAS WITHOUT CEILINGS

1 / FP101 GARAGE FLOOR PLAN

1/8" = 1'-0"

NO.	DATE	REVISION
1	06/03/2011	FIRE MARSHAL REVIEW
2	07/01/2011	OWNER REVIEW

KOHLER RONAN, LLC
CONSULTING PARTNERS
301 Main Street, Danbury, CT 06810
203.778.1017 F 203.778.1018
1370 Broadway, New York, NY 10018
212.695.2422 F 212.695.2423
www.kohlerronan.com
E-mail kroe@kohlerronan.com

CLIENT

TOWN OF WESTON
CONNECTICUT
06883

PROJECT

DEPARTMENT OF PUBLIC WORKS GARAGE SPRINKLERS

TITLE

GARAGE FLOOR PLAN - FIRE PROTECTION

DRAWN BY: AC	DRAWING
CHECKED BY: KC	FP101
SCALE: 1/4" = 1'-0"	
DATE: 07/07/11	