

Weston

Arsenic Study Update

What We Know

April 11, 2013

Mark A.R. Cooper
Director of Health



Westport Weston Health District
180 Bayberry Lane
Westport, CT. 06880
203.227.9571

Weston Arsenic Study Summary

77.3% Within Standard

22.7% Above Standard

Levels ranged from a low of zero

To a high of 0.115

◆ *Weston Findings* ◆


195 Water Analysis Received (entered as of 04/10/13)

- 114 had **no arsenic** was present = **58.4%**
- 37 had arsenic levels **0.005 to 0.010** = **18.9%**
- 32 had arsenic levels **0.011 to 0.020** = **16.4%**
- 10 had arsenic levels **0.021 to 0.030** = **5%**
- 0 had arsenic levels **0.031 to 0.040** = **0%**
- 2 had arsenic levels **0.041 to 0.050** = **1%**
- 1 had an arsenic level of **0.115**

Approximate Locations Of Arsenic Test Results

77.3% Within Standard

22.7% Above Standard

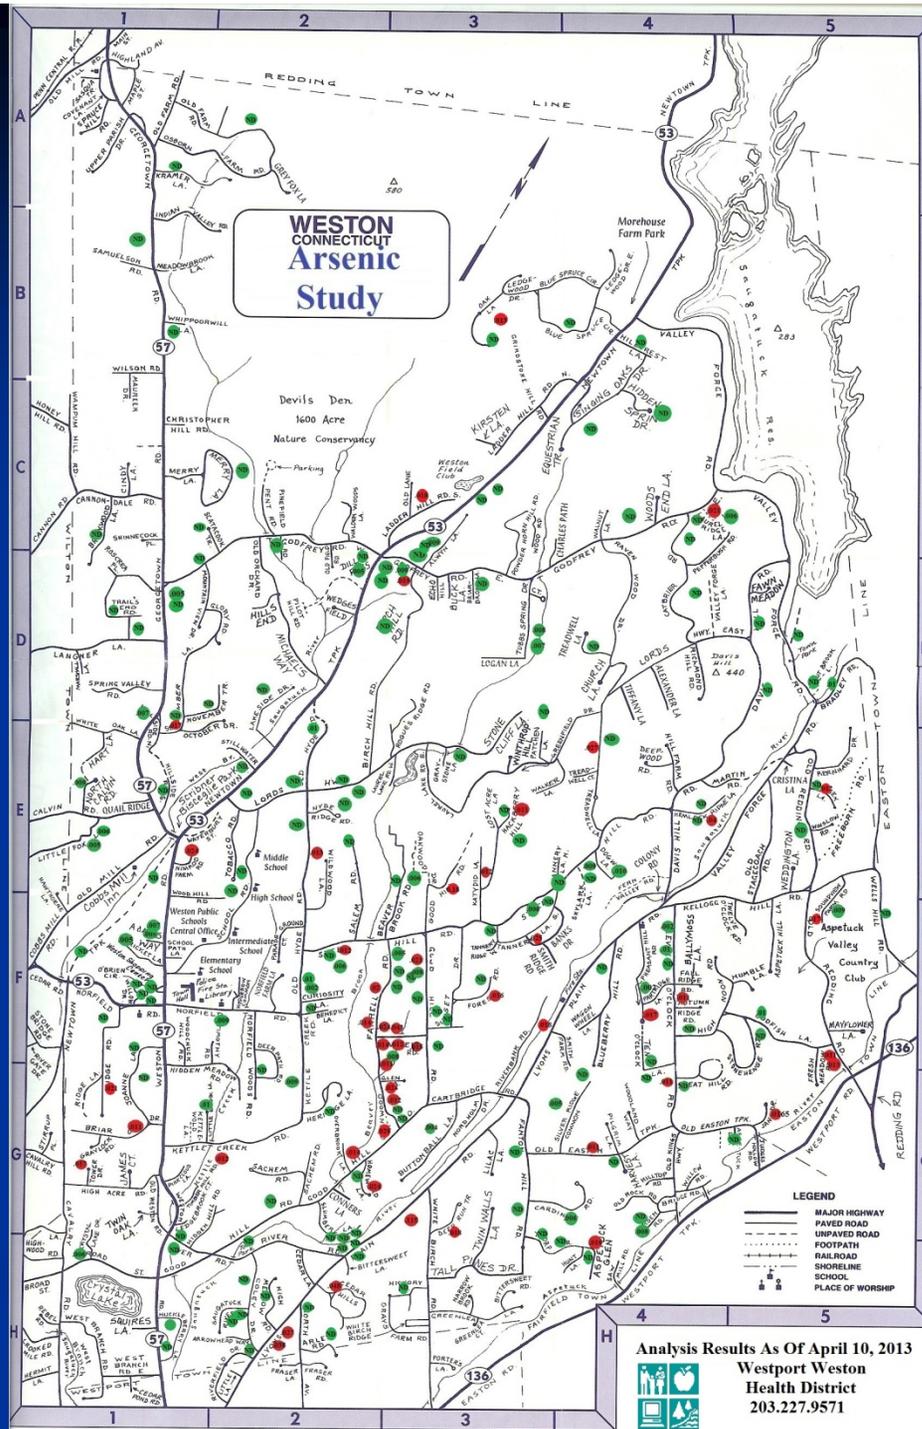



Questions
Comments
Discussion